

FT10 FUEL CONTROL MANIFOLD

FEATURES

- All stainless steel piping and tubing
- Pre-assembled and pressure tested
- Closes in <200 ms
- Spring return (fail safe)
- Safety Integrity Level (SIL) 2 to 3
- Vent valve for block and bleed
- Fuel temperature range -40 °C to +85 °C
- Better than class VI shutoff
- Compliant with CSA, ATEX, PED, API
- Certified per ASME section 9 B31.1
- Certified for use in explosive atmosphere
- Operate from line pressure


APPLICATION

The Fuel Train is designed to provide extremely fast shutoff of gaseous fuel flow to an industrial gas turbine engine. Gas flow is stopped when the valve is closed, or when pilot pressure is removed, with zero leakage from inlet to outlet. It is suitable for operation with gas temperatures between -40 and +185°F (-20 and +85°C). The valve can achieve ANSI Class IV shut-off capability. The normally-closed valve may be used for emergency and normal shut own operation. Stainless steel construction assures availability of the valve despite corrosive service conditions or even catastrophic fire.

This product is suitable for use on industrial turbines up to 5820 hp output range with single or multiple combustion fuel manifold systems.

DESCRIPTION


The Fuel Train isolation valve provides shutdown on a gas turbine by rapidly halting the flow of gaseous fuel. The supply pressure is used to move a spring-loaded piston in the valve. When the valve is energized, gas pressure drives the spring-loaded piston open, admitting fuel to the turbine. When the current signal to the electrical solenoid is interrupted, the spring loaded second-stage piston changes states to vent off primary control pressure. The main spring then forces the primary piston to the seal, stopping all flow.

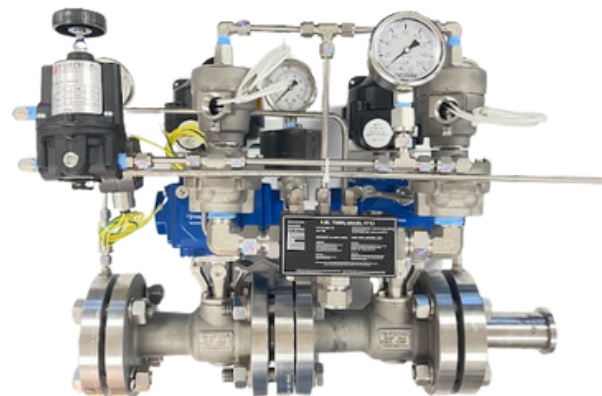

SPECIFICATION

Performance:	Closing Time Within 0.200 second
Operating Conditions / Environment	
Chemical Compatibility:	NACE Compliant for all typical gas fuels
Fuel Temperature:	-40 °C to +85 °C
Ambient Temperature:	-40 °C to +85 °C
Fuel Types:	Natural gas, propane, ethane, methane
Fuel Supply Pressure:	Normal operation 150 to 500 psig
Fuel Solid Particle Contaminant:	<10 µm diameter, 30 ppm by volume
Pilot Filtration:	10 µm
Electrical Specifications	
Voltage available:	24 Vdc, 2 amps
Wiring Interface:	½-14 NPT conduit entry
Mechanical Specifications	
Inlet:	1-1/2" socket weld flange per ANSI B16.5; 600 lb
Outlet:	SAE Series 61 1-1/2" 4-bolt flange
Regulatory Compliance	
CSA:	CSA Certified for Class I Div 1 and Div 2, Groups C & D, T4
ATEX:	Declared to 94/9/EEC
PED:	PED 97/23/EC Module H
API:	API 607, ISO 10497
Safety Integrity Level (SIL):	IEC 61508-2 SIL 2/3
Valve Design:	ANSI B16.34, API 6D / ISO 14313, ISO 17292
H2S:	NACE MR-0175, ISO 15156-1/2/3


MECHANICAL CONSTRUCTION

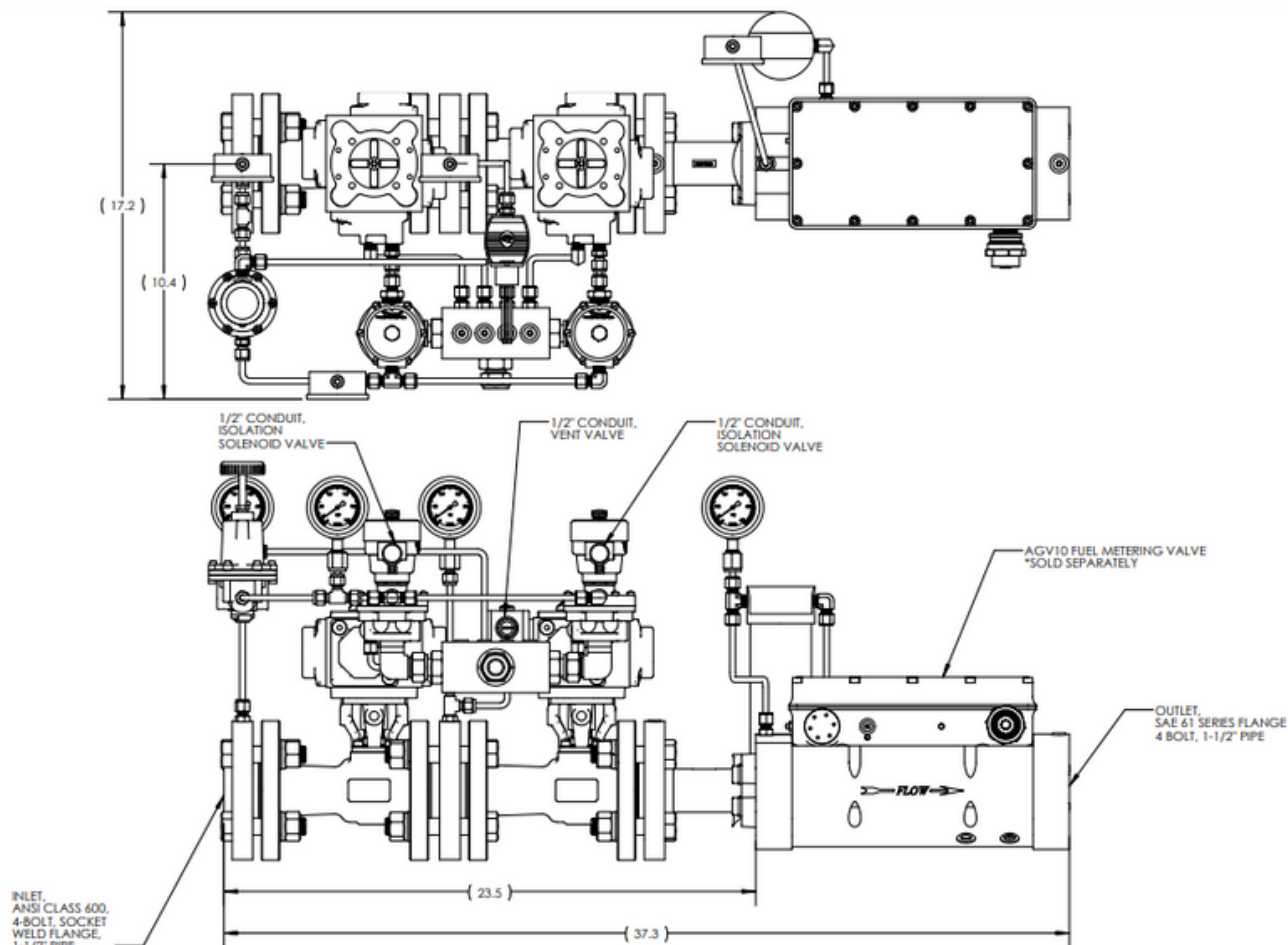

INLET,
ANSI CLASS 600,
4-BOLT, SOCKET
WELD FLANGE,
1-1/2" PIPE



FUEL TRAIN ASSEMBLY, FT10, P/N: 50109718
ENVELOPE DRAWING
CONTINENTAL CONTROLS CORPORATION
8845 RECHO RD.
SAN DIEGO, CALIFORNIA 92121 USA
PHONE: (858) 453-9880 FAX: (858) 453-5078
WWW.CONTINENTALCONTROLS.COM

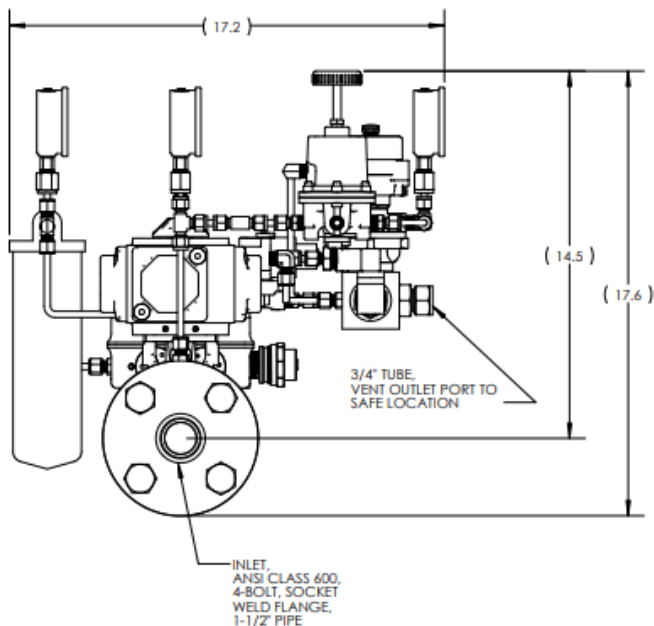

INLET,
ANSI CLASS 600,
4-BOLT, SOCKET
WELD FLANGE,
1-1/2" PIPE

LEAKAGE TESTING

Habonim refers to the international standards for valve testing:

- API 598
- ISO 15848-2
- API6D
- EN 12266-1/2
- ISO 5208
- BS 6364

Strength/Valve shell leak test:

- Tested per quality system procedures
- By usage of compressed air, nitrogen, or water

In-Line Leak Test:

- 100% of valves are tested
- By compressed air, nitrogen or helium
- At 5-7 bar pressure
- Pass Criteria:
 - Rate A result (bubble tight shutoff) for soft seated valves

Functional Test:

- 100% of valves are tested
- Torque is tested to design limits



+1(858)453-9880

info@continentalcontrols.com

7710 Kenamar Court, San Diego, CA 92121